

# PROGRAMMABLE DISPLAY UNIT PDU-420-W

- Suitable for connecting water level meters with a current or voltage output.
- 4-digit LED display.
- 2 relay outputs
- Includes an auxiliary voltage power supply for current loop 4 ... 20 mA.
- Wall-mounted case (IP65).
- Communication interface RS-485 / Modbus RTU.
- Power supply 230 V AC or 24 V DC.





The PDU-4x0-W meter is equipped with one current input 0-20 / 4-20mA and one voltage input 0-5 / 1-5 / 0-10 / 2-10V. Current input has additionally overcurrent protection circuit, which protects standard resistor. The selection of active input is realised by software, and selected input can be changed at any time. Additionally the PDU-420-W allows user to select a conversion characteristic of several kinds: linear, square, square root, user defined (max.20 points length) and volume characteristics of a cylindrical tank in the vertical and horizontal position. Result is showed on 4-digit LED display.

#### RANGE OF APPLICATION


The unit is designed to be coupled with the level meter, which is connected via current or voltage output. The unit continually displays level in any physically units, according to selected limits, it can control switching of connected equipment (pumps, valves etc.) and it can be used as power supply for level meters too.


# **VARIANTS OF UNITS**

• PDU-420-W-24V 2 independent relay outputs (2 limits), wall-mounted unit. Power supply 24 V, interface RS-485 / Modbus RTU. Optional accessories – infrared remote controller RCW-1.

• PDU-420-W-230V 2 independent relay outputs (2 limits), wall-mounted unit. Power supply 230 V, interface RS-485 / Modbus RTU. Optional accessories – infrared remote controller RCW-1.


#### **DIMENSIONAL DRAWINGS**





# **TERMINAL DESCRIPTION**

Unit terminal block							
terminal No.	PDU-420-W		terminal No.	PDU-420-W			
1	L / + (230 / 24 V)		9				
2	N / - (230 / 24 V)		10	+IN (voltage)			
3	RE 2		11	+IN (current)			
4	RE 2		12	GND			
5	RE 1		13				
6	RE 1		14	A + (RS 485)			
7	+Uo		15	B - (RS 485)			
8	+Uo		16	GND (RS 485)			

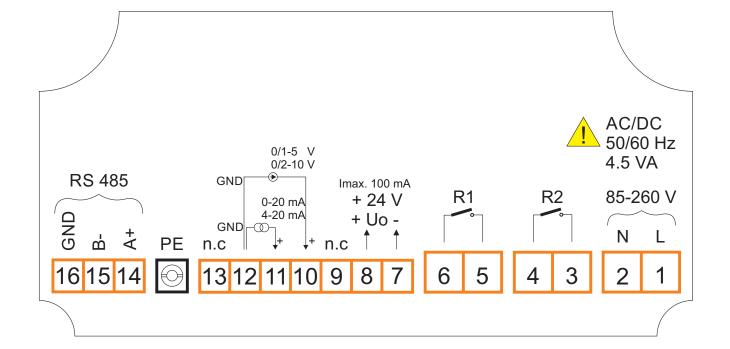

## **TECHNICAL SPECIFICATIONS**

BASIC TECHNICAL DATA					
Location		panel version			
Power supply voltage version 230 V version 24 V		230 V AC ±10% 24 V DC ±15%			
Power consumption version 230 V version 24 V		2,6 VA 4,5 W			
Voltage input		current 0/4 20mA (limited input current to 40mA) voltage 0/1 5 V; 0/2 10 V			
Voltage input resistance		$< 65 \Omega$ (current input) > 50 kΩ (voltage input)			
Display range		-999 - 9999, plus decimal point			
Voltage measurement accuracy		±0,25% (±one digit over the entire measuring range)			
Display		4-digit, seven-segment, LED, red			
Outputs relay		2 (relay 1A / 250 V AC)			
Sensor power supply outputs version 230 V version 24 V		24 V DC ±3 V, max. 25 mA 24 V DC ±15%, max. 100 mA			
Outputs		-			
Communication interface		RS–485, 8N1 and 8N2, Modbus RTU, no galvanic separation			
Baud rate		1 200 115 200 bit/s			
Operating temperature		0 +50°C; (-20 +50°C)*			
Storage temperature		-10 +70°C; (-20 +70°C)*			
Protection		IP65			
Housing material		ABS + fiberglass			
Weight		cca 340g			


<sup>\*</sup> special design for an extra charge

### **ELECTRICAL CONNECTION**


The unit is not equipped with an internal fuse or power supply circuit breaker. Because of this an external time-delay cut-out fuse with a small nominal current value must be used (recommended bipolar, max. 2A) and a power supply circuitbreaker located near the unit. In the case of using a monopolar fuse it must be mounted on the phase cable (L). The power supply network cable diameter must be selected in such a way that in the case of a short circuit of the cable from the side of the unit the cable shall be protected against destruction with an electrical installation fuse.

Note: In case of measurement (evaluation) of the values from the level meter located in areas with explosion hazard, it is necessary to install an isolating repeater between the PDU display unit and the level meter.


# Explosive areas Connection of the sensors with shielded cable

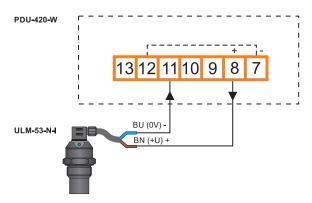


Connection diagram - level meter with current output to PDU unit, using internal power source

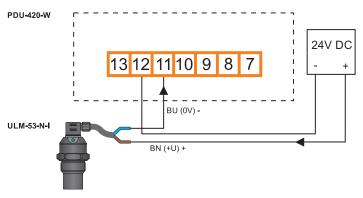

Connection diagram - level meter with current output to PDU unit, using external power source

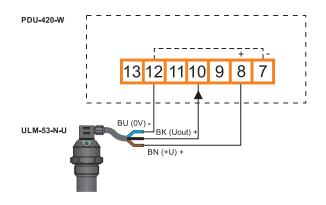

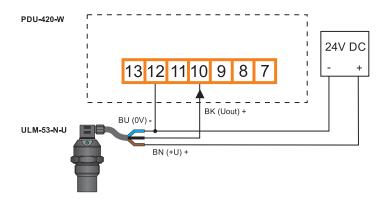

Connection diagram - level meter with voltage output to PDU unit, using internal power source


Connection diagram - level meter with voltage output to PDU unit, using external power source

(<u>i</u>)

Connection diagram is the same for all types of level meters with current or voltage outputs.

#### **Explosive areas**


# Connection of the sensors without shielded cable

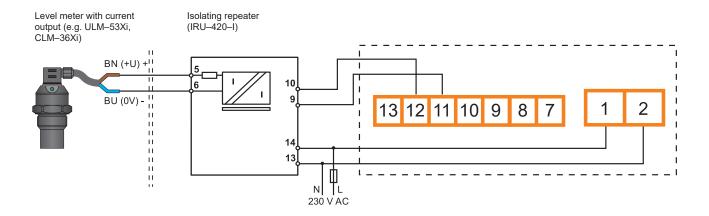


Connection of the unit to the level meters with current output located in explosive areas

#### Non-explosive areas

# Connection of the sensors with shielded cable

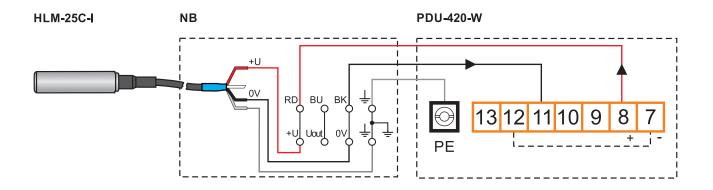

Connection diagram - level meter with current output to PDU unit, using internal power source

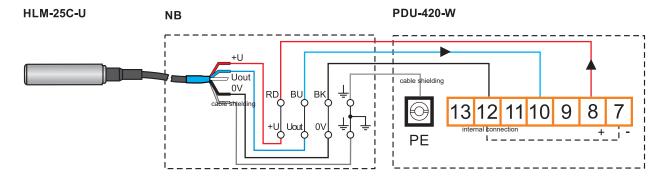

Connection diagram - level meter with voltage output to PDU unit, using internal power source

 Legend:
 RD - red
 BK - brown

 BU - blue
 BN - black


<u>(1)</u>

If junction box with integrated overvoltage protection is used, the sensor must be connected to the bottom contacts of the terminal block. These contacts are identified with SENSOR label.

# **FUNCTION AND STATUS INDICATION**

LED control	colour	function
"AL"	red	lit – input current (voltage) on the terminals "+ IN" is outside of the allowed range (adjustable) dark – correct function
"R 1"	red	lit – relay RE 1 is energized (threshold status value exceeded) dark – relay RE 1 de-energized (threshold status value not reached)
"R 2"	red	lit – relay RE 2 is energized (threshold status value exceeded) dark – relay RE 2 de-energized (threshold status value not reached)

# ORDER CODE

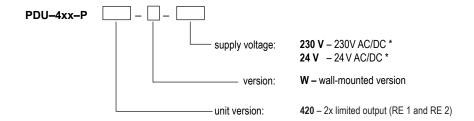

# **CORRECT SPECIFICATION EXAMPLES**

#### PDU-420-W-230V

(420) 2x limited output (RE 1 and RE 2); (W) wall-mounted version; (230V) supply voltage 230 V AC ± 10 %; (RWC-1)

#### PDU-420-W-24V

(420) 2x limited output (RE 1 and RE 2); (W) wall-mounted version; (230V) supply voltage 24 V DC ± 15%

# **Accessories**

#### optional - for an extra charge

(see the Accessories Catalogue List)

• Infrared remote controller RCW-1 (for PDU-420-W type only)

# SAFETY, PROTECTIONS, COMPATIBILITY AND EXPLOSION PROOF

PDU-4xx-P display unit is equipped with power supply voltage polarity reversal, protection against overcurrent and protection against short-term overvoltage.

Protection agains hazardous contact is provided through small safe voltage, according to EN 33 2000-4-41. The electrical equipment of the protection class II. Conected to 230 V power supply only through fuse or breaker (max. 2A).

The electrical equipment of the protection class II. Electrical safety according to EN 61010-1.

The electromagnetic compatibility is ensured by compliance with standards EN 61326.